STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
DIVISION OF HIGHWAYS

MICHAEL F. EASLEY
GOVERNOR

LYNDO TIPPETT
SECRETARY

January 20, 2010

TIP NUMBER: B-4237
WBS ELEMENT: 33580.3.1

DESCRIPTION: Replacement of Bridge #25 over Fork Swamp in Pitt County
ADDENDUM NUMBER 1

TO: Prospective Bidders

Please note the following revision to the contract proposal for the above-referenced project.

- Replace plan sheets UC2 and UC3 with the attached sheets, denoting a change to ductile iron pipe.

The remainder of the proposal document is unaffected.

If you should have any questions concerning this, please call me at (252) 695-2044.

Sincerely,

Aaron Bullard, PE
Division Contract Officer

Attachments

cc: Mr. Ed Eatmon, PE, Division Construction Engineer
Mr. Bill Kincannon, PE, Resident Engineer

Division Two • P.O. Box 1587 • Greenville, N.C. 27835
Telephone 252-695-2044 • Fax 252-830-3341

PROJECT REFERENCE NO.	SHEET NO.
B-4237	UC2
UTILITY DESIGN ENGINEER	UTILITY DESIGN ENGINEER
NORTH CAROLINA PROFESSIONAL SEAL 16710 ENGINEER DWAYNE H. ALLIGOOD 01/20/10	THIS DOCUMENT ORIGINALLY SIGNED AND SEALED BY DWAYNE H. ALLIGOOD (16710) ON 12/14/09

*REVISED 01/2010 TO REPLACE 10" PVC WITH 10" DIP.

UTILITY CONSTRUCTION

STATE OF NORTH CAROLINA
DIVISION OF HIGHWAYS
SUMMARY OF QUANTITIES

BRIDGE NO.	QUANTITY	UNIT	ITEM DESCRIPTION
BRIDGE #25	321	LF	12" HDPE PIPE DR9 (AWWA C906)
	364	LF	10" DIP PIPE
	2	EA	10" GATE VALVE
	2	EA	HDPE TO DI PIPE TRANSITION
	0.50	ACRE	SEEDING AND MULCHING
	456	LF	TEMPORARY SILT FENCE

REVISIONS

*REVISED 01/2010 TO REPLACE 10" PVC WITH 10" DIP.

8/17/99

26-JAN-2010 14:06
C:\PROJECTS\PTT#25\ptt25_ddc2_waterbore_uc2revised.dgn
$$$$USERNAME$$$$

PROJECT REFERENCE NO.	SHEET NO.
B-4237	UC3
UTILITY DESIGN ENGINEER	UTILITY DESIGN ENGINEER

NORTH CAROLINA PROFESSIONAL SEAL 16710 ENGINEER DWAYNE H. ALLIGOOD 01/20/10

THIS DOCUMENT ORIGINALLY SIGNED AND SEALED BY DWAYNE H. ALLIGOOD (16710) ON 12/14/09

*REVISED 01/20/10 TO REPLACE 10" PVC WITH 10" DIP.

UTILITY CONSTRUCTION

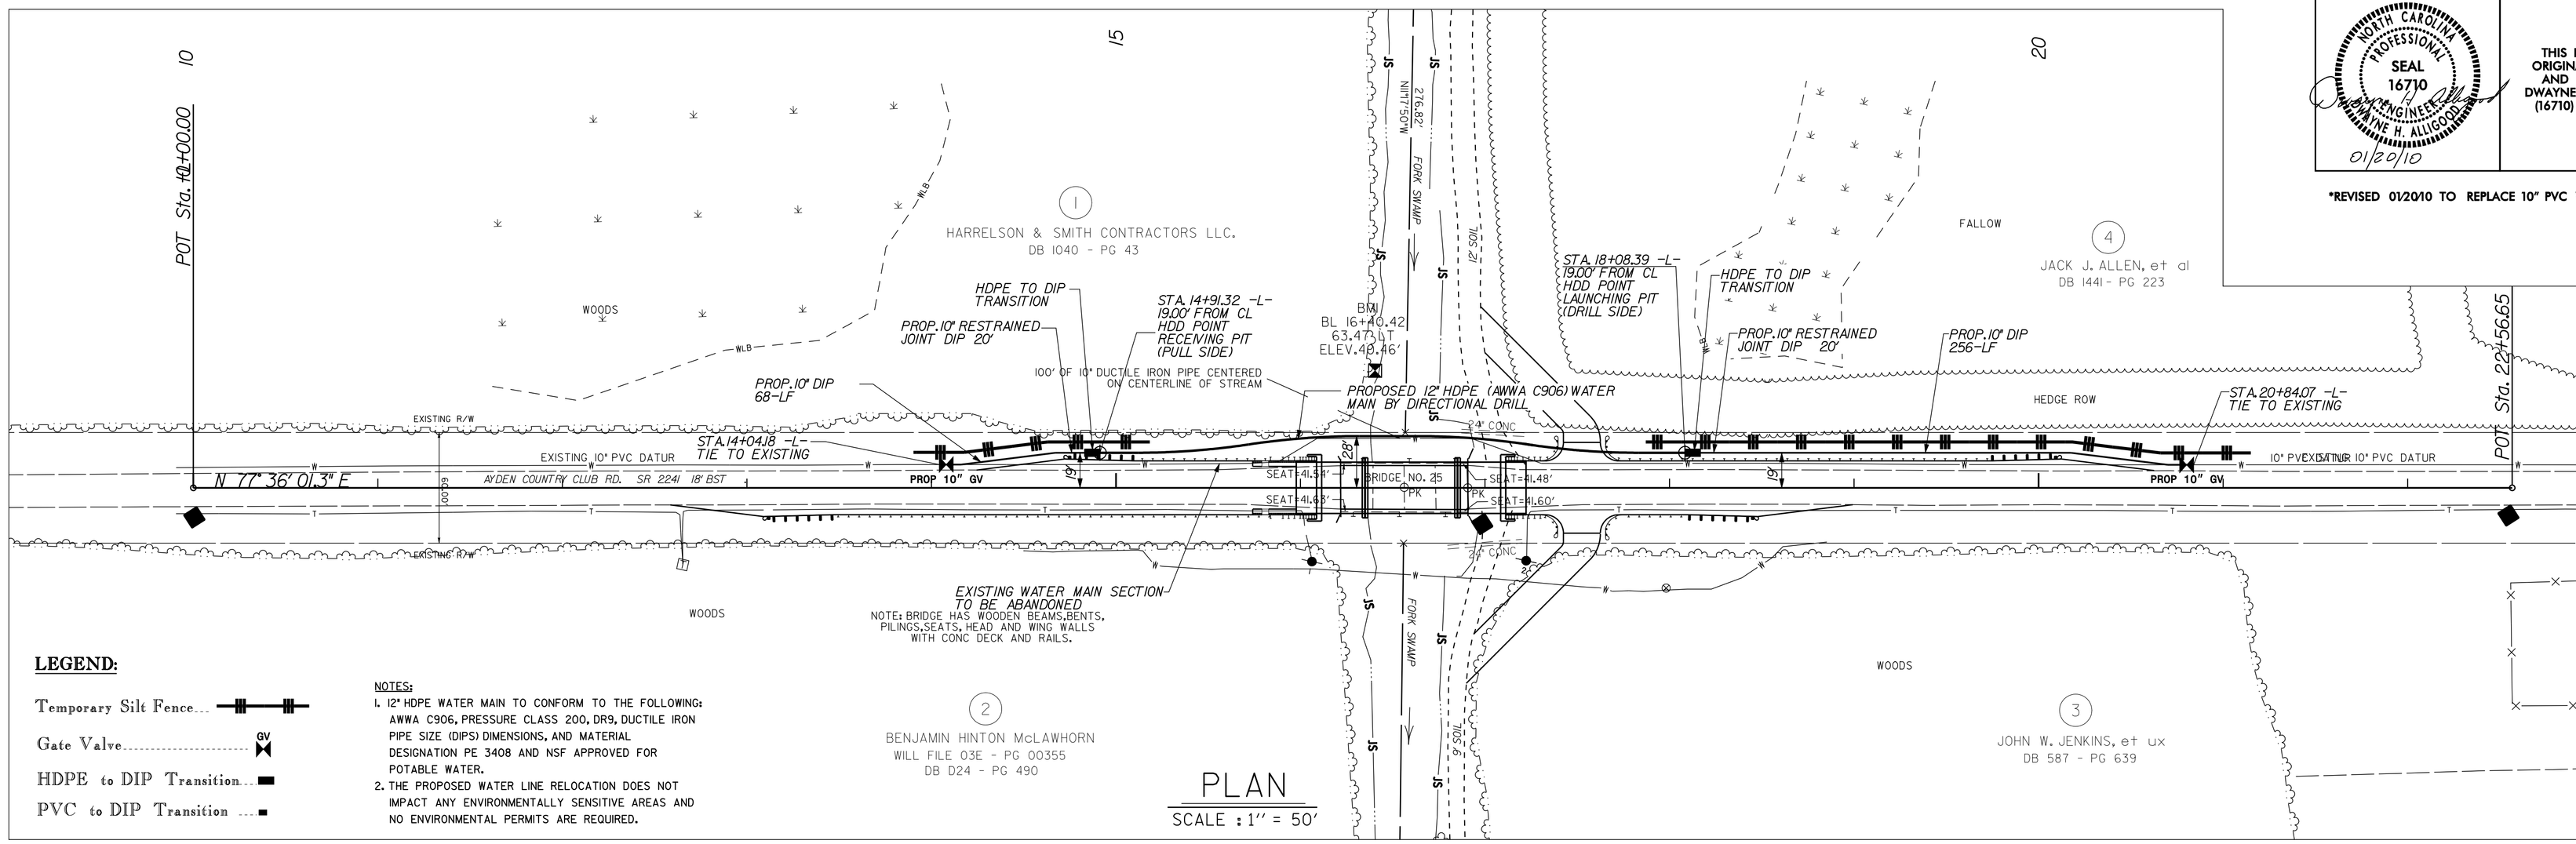

LEGEND:

Temporary Silt Fence...

Gate Valve.....GV

HDPE to DIP Transition...

PVC to DIP Transition ...

NOTES:
1. 12" HDPE WATER MAIN TO CONFORM TO THE FOLLOWING: AWWA C906, PRESSURE CLASS 200, DR9, DUCTILE IRON PIPE SIZE (DIPS) DIMENSIONS, AND MATERIAL DESIGNATION PE 3408 AND NSF APPROVED FOR POTABLE WATER.
2. THE PROPOSED WATER LINE RELOCATION DOES NOT IMPACT ANY ENVIRONMENTALLY SENSITIVE AREAS AND NO ENVIRONMENTAL PERMITS ARE REQUIRED.

PLAN

SCALE : 1" = 50'

PROFILE ALONG PROPOSED WATER MAIN

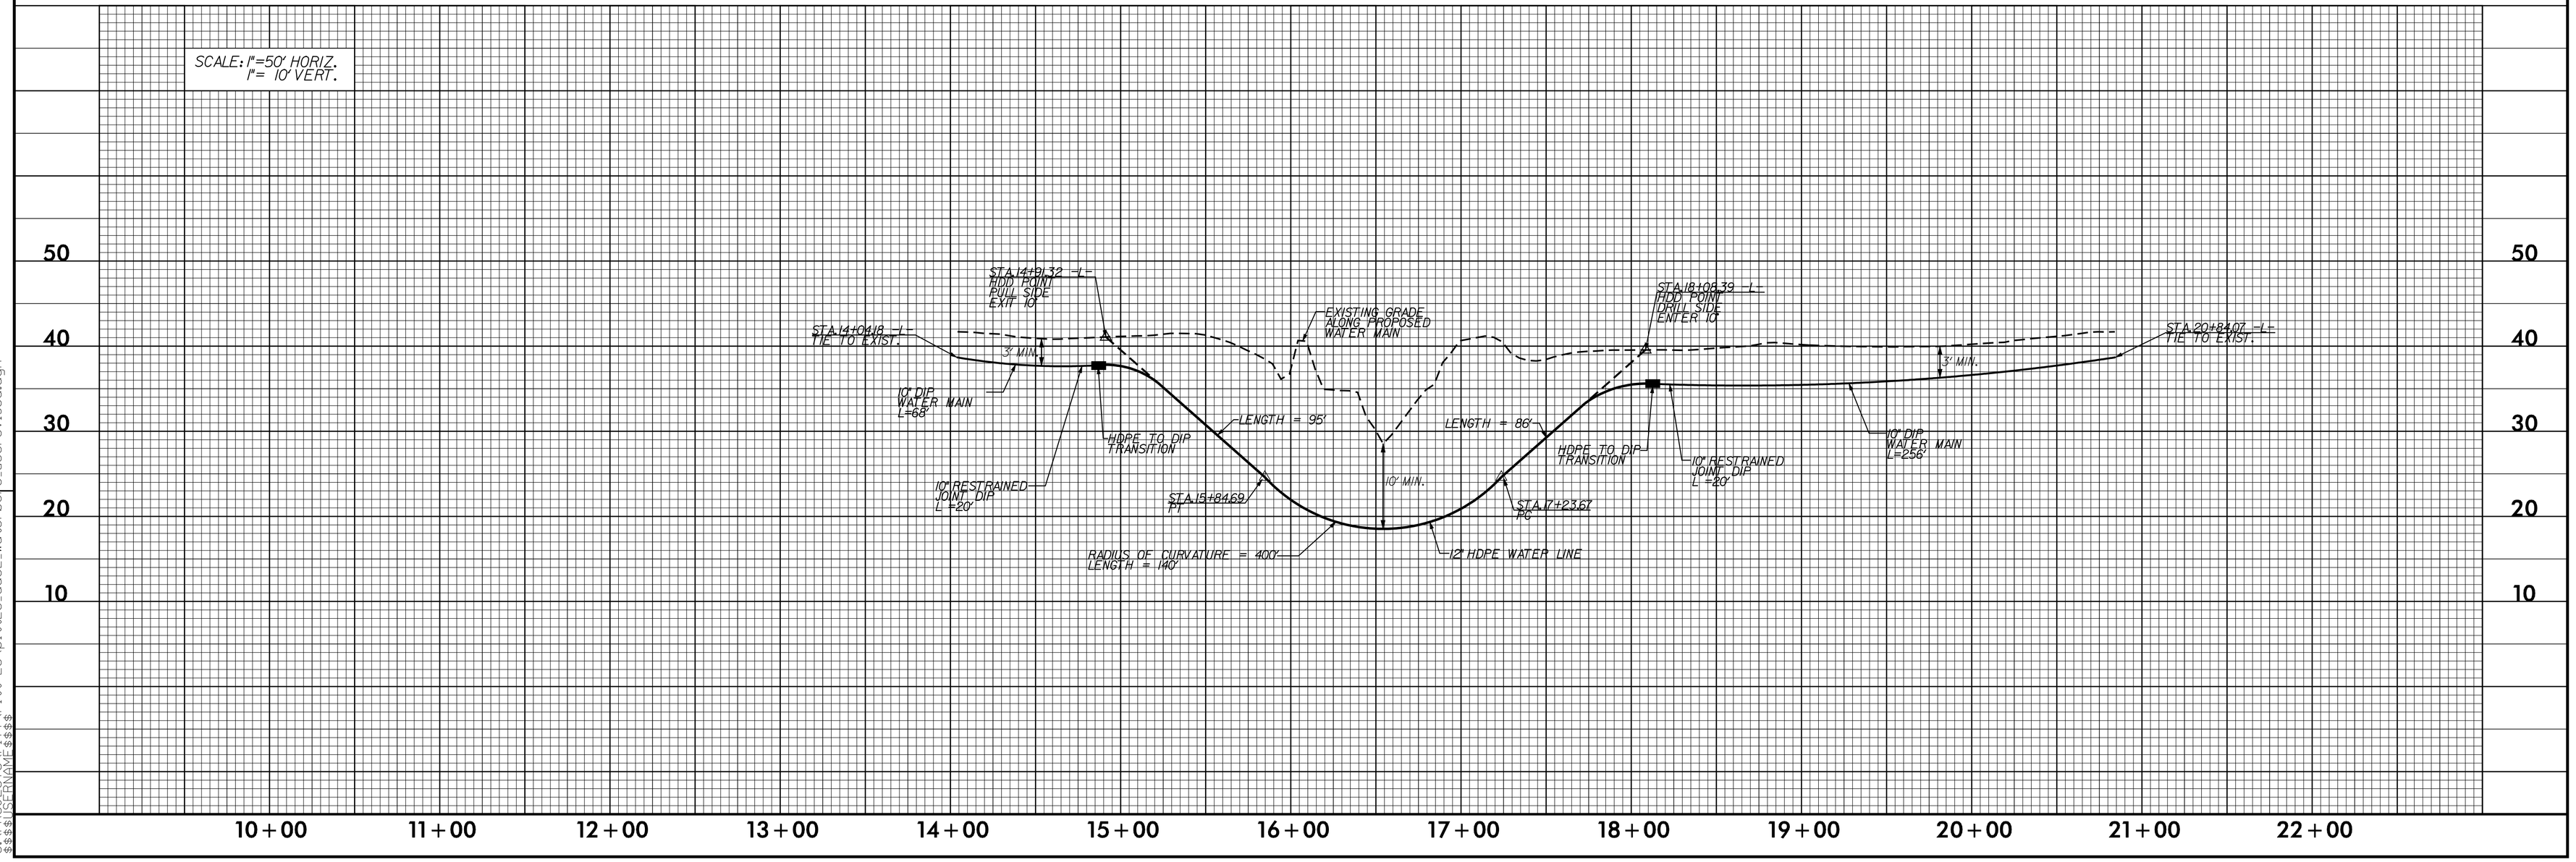

REVISIONS

*REVISED 01/20/10 TO REPLACE 10" PVC WITH 10" DIP.

8/17/99

20-JAN-2010 14:06
c:\pwworking\d0394\d0394\d0394\mr\Pitt#25\pitt25_ddc2_waterbore_uc3revised.dgn
$$$$USERNAME$$$$